


Krang

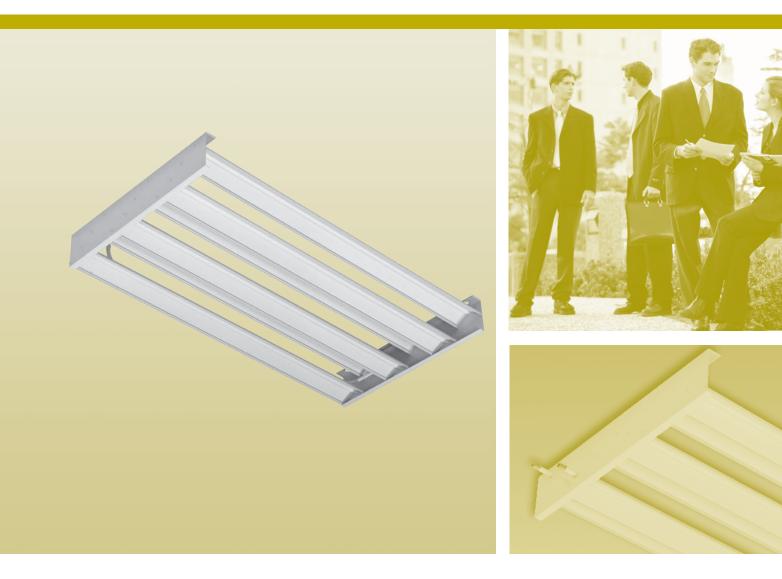


Static cooling ceiling system SKS-4/3-duo

Static cooling ceiling system SKS-4/3-duo

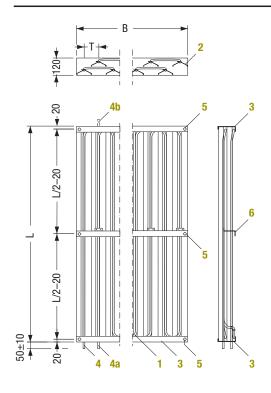



Graph A: Specific cooling output qK



Graph B: Correction factors for suspended ceiling $k_{\mbox{\scriptsize D}}$ and covered area $k_{\mbox{\scriptsize B}}$

High-capacity cooling element designed for installation above open, suspended ceilings. It consists of copper serpentine piping with connections for chilled water inflow and outflow, cooling fins made from aluminium profile and endwise metal profiles for fin fastening, with mounting holes. Thanks to its design featuring an optimum arrangement of the cooling fins, this stable cooling ceiling element is ideal for spaces with rather high heat loads.

Key:

- 1 Copper serpentine piping ø 12 mm
- 2 Cooling fin of aluminium
- 3 U-shaped frame profile of sheet metal
- 4 2 chilled water connections for
- $A_{SKS} \le approx. 2.5 \text{ m}^2$, otherwise 4 connections
- 4a Even number of fins
- 4b Odd number of fins
- 5 Mounting holes
- 6 Rear fastening profile for $L \ge 3000 \text{ mm}$

- **Features:**
- Cooling output: 216 W/m² of cooling element without suspended ceiling (with reference to DIN 4715), with high heat removal by convection and radiation
- Particularly suitable for high cooling outputs for offices with rather high heat loads, TV studios, mechanical rooms, or industrial spaces
- The system uses the retention capacity of the concrete ceiling
- Design and installation of mechanical equipment and ceiling can largely occur separately
- Combinable with any air distribution system
- Excellent dynamic response
- No combustible components

Dimensions:

1 000 mm \leq L \leq 4 000 mm in steps of 100 mm
400 mm \leq B \leq 1 200 mm in steps of 100 mm
120 mm
100 mm
≥ 200 mm
Powder coating to RAL (standard: RAL 9005)
Pipe ends for push-in fittings or press-fitted connections
\leq 6 bars
approx. 13 kg/m ² when filled with water

Taking account of the graphs on the left, the achievable cooling output \dot{q} will be calculated from $\dot{q} = \dot{q}_K \cdot k_D \cdot k_\beta.$

Technical layout data, e.g. waterside pressure drop etc., will be made available upon request.

Subject to technical alteration.



Krantz GmbH

Uersfeld 24, 52072 Aachen, Germany Phone: +49 241 441-1 Fax: +49 241 441-555 info@krantz.de | www.krantz.de

know